


B

VS 10-75 CG uPC (AHU VS 21-75)
VS 40-150 CG uPC SUP-EXH
VS 180-300 CG uPC
VS 400-650 CG uPC

APPLICATION: AR4162 / AR4290

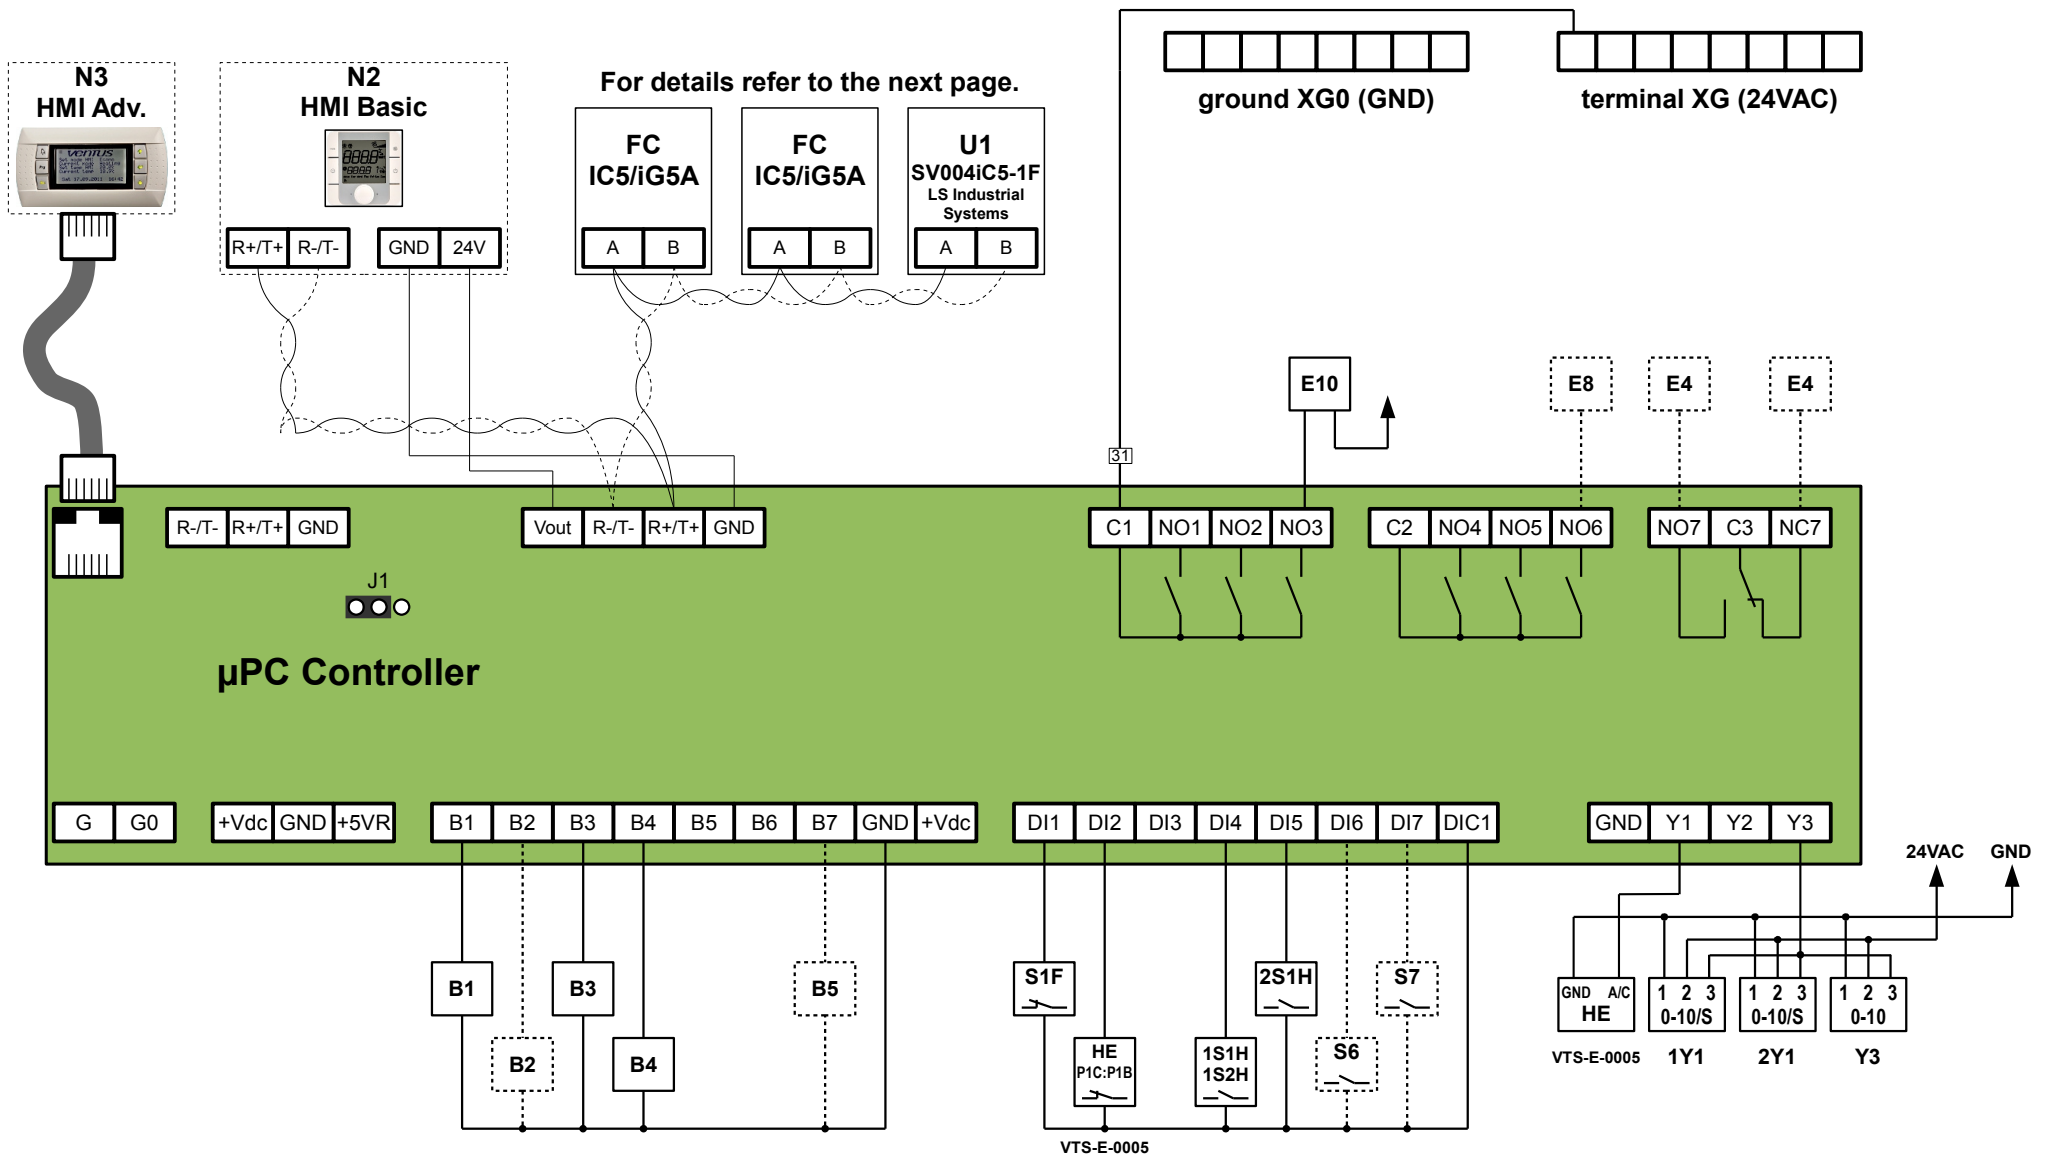

For details refer to the next page.

ground XG0 (GND)

terminal XG (24VAC)

VTS-E-0005 1Y1 2Y1 Y3

VTS-E-0005

B

MODBUS CONNECTION



SENSOR B2

| | HMI Basic uPC = YES | HMI Basic uPC = NO |
|-----------------|---------------------|--------------------|
| App.Code A...-S | ✗ | ✗ |
| App.Code A...-R | ✗ | B2 ✓ |
| App.Code A...-E | B2 ✓ | B2 ✓ |