



SUSPENDED AIR HANDLING UNITS


> with counter-flow heat exchanger (hex)

FLOOR MOUNTED AIR HANDLING UNITS

> with rotary heat exchanger or hex counter-flow heat exchanger



VVS055c

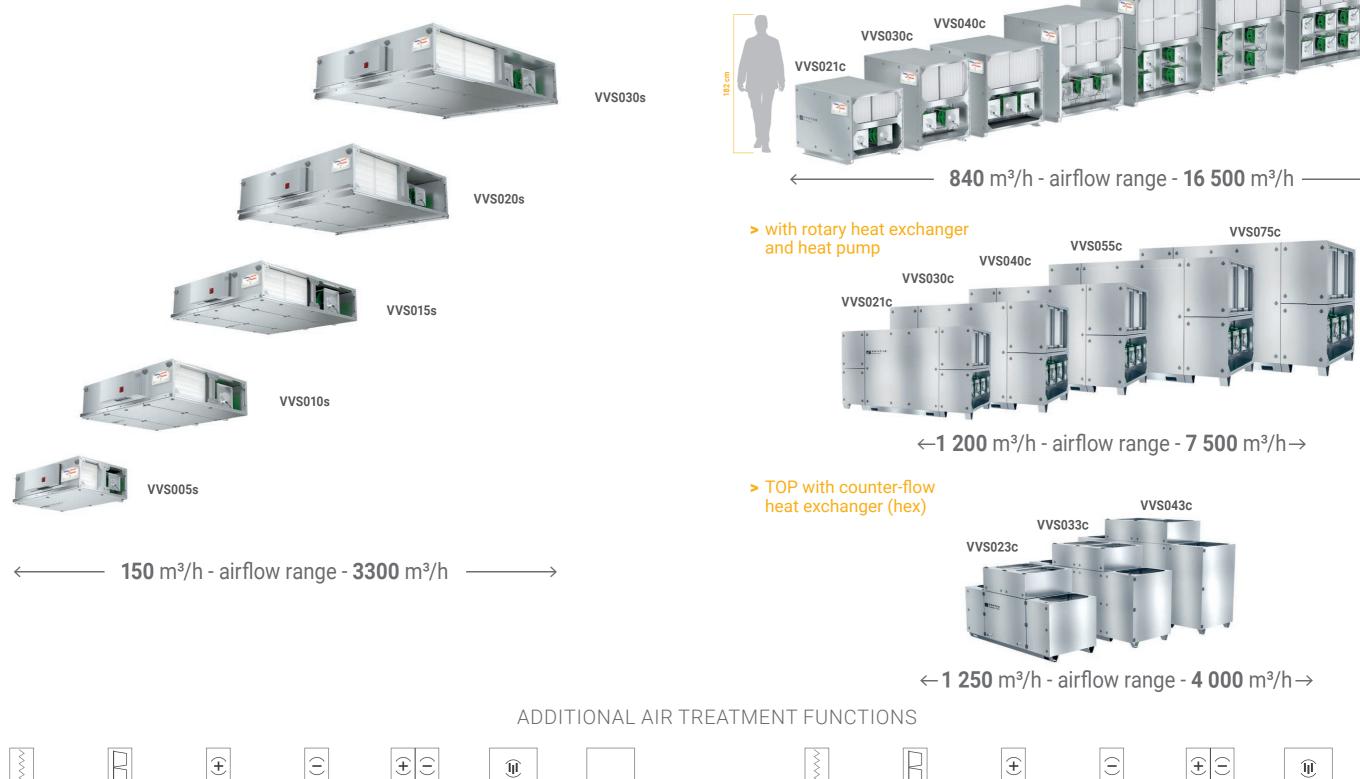

Mini-Pleat



-		ŀ















Sound attenuator

Additional empty space

Mini-Pleat air filter

Bag filter

Heater



2











Sound attenuator



VENTUS COMPACT SUSPENDED AIR HANDLING UNITS



max. 490 mm





HIGHLY EFFICIENT HEX COUNTER-FLOW HEAT RECOVERY



ENERGY SAVING



AND SILENT FANS WITH EC MOTORS



PLUG&PLAY PRODUCT





MULTIFUNCTIONAL CONTROLS

VENTUS COMPACT FLOOR MOUNTED AIR HANDLING UNITS





VENTUS Compact TOP with hex counter-flow heat exchanger




MINERAL WOOL INSULATION

HIGHLY EFFICIENT ROTARY AND HEX COUNTER-FLOW HEAT EXCHANGER

ENERGY SAVING AND SILENT FANS WITH EC MOTORS

> VENTUS Compact

















VENTUS Compact with rotary heat exchanger or hex counter-flow heat exchanger





PLUG&PLAY PRODUCT



INTEGRATED MULTIFUNCTIONAL CONTROLS

> Standard Air Handling Units



VENTUS COMPACT SUSPENDED AIR HANDLING UNITS

CASING

- » Panels filled with mineral wool, enclosed with steel sheet on both sides.
- » Casing parameters according to EN 1886: T2, TB3, L1, D1, F9.

MINI-PLEAT FILTERS

- » Supply EU7 (ePM2,5 65%)
- » Exhaust EU5 (ePM10 50%)



EC MOTORS

» Efficient, silent and low vibrations fan with electronically commutated motor in a IE4 class.


ENERGY RECOVERY

- » Highly efficient counterflow hex recovery with by-pass.
- » Recovery efficiency reaching 90%.

RECUPERATOR BY-PASS

- » Stepless adjustment of heat recovery capacity.
- » Passive cooling function.
- » Recuperator frost protection.

Air filters with extended high efficiency filtration surface.

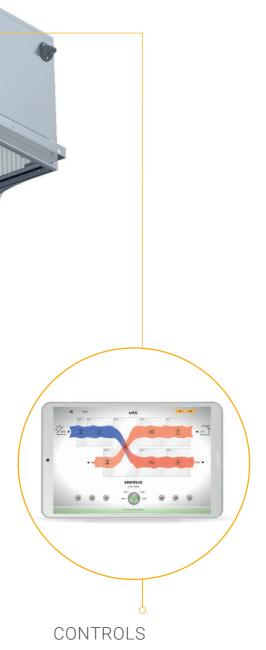

» Multifunctional controls, integrated with the unit – fully pre-configured and ready to run.

VENTUS COMPACT TOP FLOOR-MOUNTED UNITS WITH VERTICAL DUCT CONNECTION

CASING

- » Panels filled with mineral wool, enclosed with steel sheet on both sides.
- » Casing parameters according to EN 1886: T2, TB3, L1, D1, F9.
- » Fan and filter section panels fitted with hinges.





DIMENSIONS

- » Unit width 88 cm can be transported through the opening of 90 cm without disassembling the device.
- CONTROLS
- » Multifunctional controls, integrated with the unit – fully pre-configured and ready to run.

ENERGY RECOVERY

- » Highly efficient counterflow hex recovery with by-pass.
- » Recovery efficiency reaching 90%.

- » Supply EU7
- » Exhaust EU5

MINI-PLEAT OR BAG FILTERS

Air filters with extended high efficiency filtration surface.



VENTUS COMPACT FLOOR MOUNTED AIR HANDLING UNITS

CASING

- » Panels filled with mineral wool, enclosed with steel sheet on both sides.
- » Casing parameters according to EN 1886: T2, TB3, L1, D1, F9.





- » Recovery efficiency reaching 86%.

ENERGY RECOVERY

by EC motor.

MINI-PLEAT FILTERS

Air filters with extended high efficiency filtration surface. » Supply - EU7 (ePM2,5 65%) » Exhaust - EU5 (ePM10 50%)

VENTUS COMPACT FLOOR MOUNTED UNITS WITH HEAT PUMP

CONVENIENT TRANSPORT, QUICK INSTALLATION


» The unit is divided into easy to transport and easy to assemble complete functional modules

FOR USE IN ANY FACILITY

- » No external refrigeration equipment taking up space in your facility
- » No external noise sources

OPTIMUM MATCHING

- » Factory fit of heat pump and air handling unit components
- » Manufacturer's warranty on the final air handling unit and heat pump product

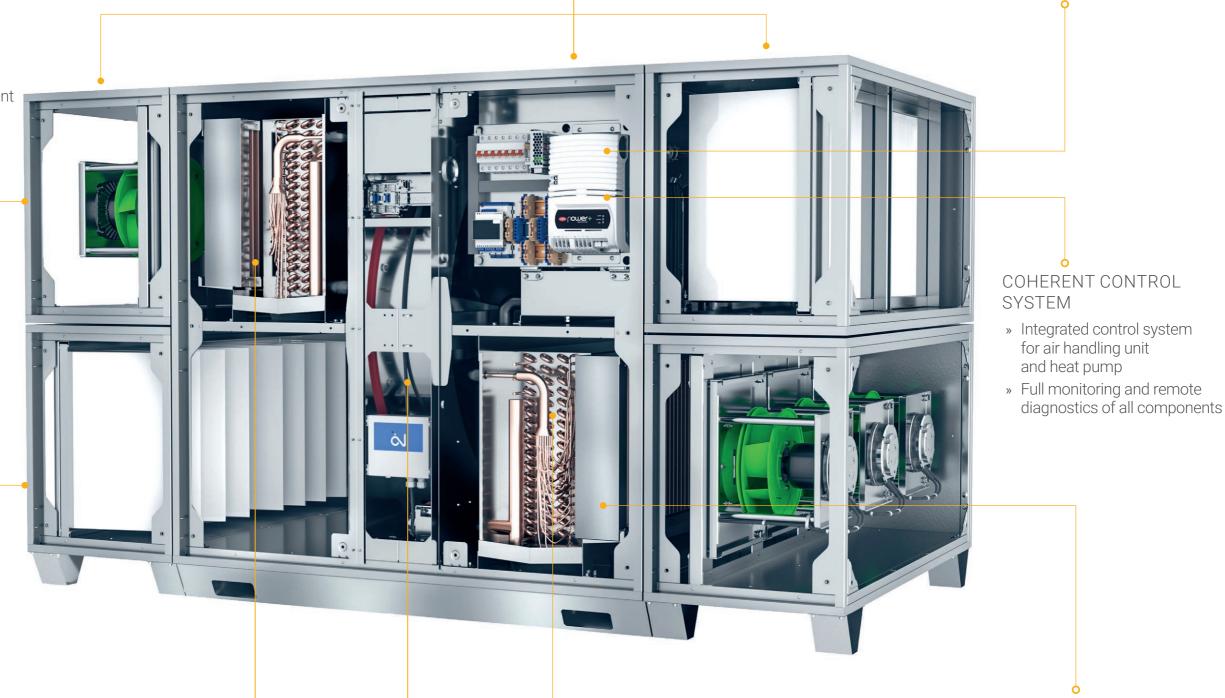

HIGH ENERGY EFFICIENCY

- » High efficiency sorption rotary regenerator for excellent heat and moisture recovery
- » Installation of multi-row condensers and evaporators $^{\circ}$ on both sides of the regenerator ensures the most efficient operation of the heat pump

EASY COMMISSIONING

- » Multifunctional factory assembled controls ready to work as soon as the unit is assembled
- » Easy commissioning without service

HEAT PUMP FUNCTIONS

» Supply air cooling in summer » Reduction of supply air heating costs during other periods of the year

VENTUS COMPACT FLOOR MOUNTED UNITS WITH HEAT PUMP

• SMOOTH REGULATION OF HEATING AND COOLING POWER


- » Inverter compressor with DC motor smoothly adjusts cooling and heating power
- » Controller equipped with sensors fully controls cooling parameters of the heat pump system

HEATING AND COOLING FUNCTION

- » Four-way valve automatically switches reverse operation modes
- » Automatic defrosting function in winter



» Electronic expansion valve dynamically adjusts fluid flow to current air handling unit parameters

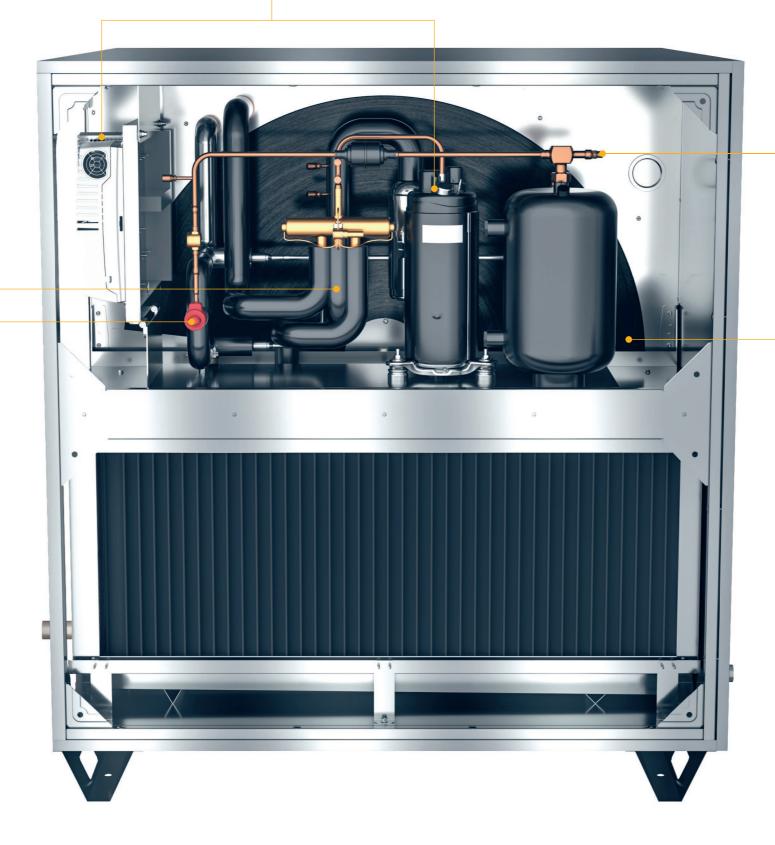

cooling and heating power g parameters of the heat pump system

• MULTI-STAGE HEAT PUMP

- » Ongoing monitoring of the production process
- » Individual leakage and operational check confirmed by electronic report
- » UDT (Office of Technical Inspection) certificate

SMOOTH REGULATION OF HEAT RECOVERY POWER

- » Electronically controlled stepper motor of the rotary heat exchanger smoothly regulates heat recovery capacity
- In winter time the automation system ensures three-stage frost protection for the rotary heat exchanger

VENTUS COMPACT SUSPENDED AIR HANDLING UNITS

Base unit overall data

Unit size	Nominal airflow	Airflow range	Height	Width	Duct connection heigth	Duct connection width
	[m ³ /h]	[m ³ /h]	[mm]	[mm]	[mm]	[mm]
VVS005s	500	150 - 650	400	770	318	305
VVS010s	1000	300 - 1100	400	1190	318	515
VVS015s	1500	450 - 1650	400	1590	318	715
VVS020s	2000	600 - 2200	490	1650	408	743
VVS030s	3000	900 - 3300	490	2200	408	1018

Section length

Unit size		F	Н	С	HC
	Base unit		Additional a	ir treatment functions	
	[mm]	[mm]	[mm]	[mm]	[mm]
VVS005s	1350	320	320	390 - 480	480 - 800
VVS010s	1500	220	220	390 - 480	480 - 780
VVS015s	1500	220	220	390 - 480	480 - 780
VVS020s	1828	220	220	390 - 480	480 - 780
VVS030s	1828	220	220	390 - 480	480 - 780

Duct accessories

Dimmension WxH [mm]	VVS005s	VVS010s	VVS015s	VVS020s	VVS030s
Flexible connection	305x313	485x288	685x288	730x375	1005x375
Air damper	305x313	485x288	685x288	730x375	1005x375
Rectangle spigot	305x313/300x300	510x310/400x350	710x310/400x350	740x400/500x400	1015x400/800x400
Rounded spigot	305x313/355	510x310/355	710x310/355	740x400/450	1015x400/450

VENTUS COMPACT FLOOR MOUNTED AIR HANDLING UNITS

Base unit overall data

Unit size	Nominal airflow	Airflow range	Height	Width	Duct connection heigth	Duct connection width
	[m ³ /h]	[m ³ /h]	[mm]	[mm]	[mm]	[mm]
VVS021c	2100	840 - 2310	991	967	345	860
VVS030c	3000	900 - 3300	1255	967	480	860
VVS040c	4000	1200 - 4400	1255	1174	480	1065
VVS055c	5500	1650 - 6050	1525	1345	615	1235
VVS075c	7500	2250 - 8250	1765	1486	735	1380
VVS100c	10000	3000 - 11000	1965	1666	835	1560
VVS120c	12000	3600 - 13200	2039	1897	870	1790
VVS150c	15000	4500 - 16500	2241	2091	970	1985

Height includes 90 mm base rail

Base unit lengths

Unit size	(b) (c) (c) (c)			3 3 3 3 8 B	3/ 3 E	3 8 8 8 8
	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
VVS021c	1240	1080	1080	2 230	2 230	2 500
VVS030c	1240	1080	1080	2 230	2 230	2 500
VVS040c	1240	1080	1080	2 230	2 230	2 500
VVS055c	1240	1080	1080	2 290	2 290	2 560
VVS075c	1240	1080	1080	2 530	2 530	2 800
VVS100c	1300	1300	1080	2 570	2 570	2 800
VVS120c	1300	1300	1080	2 670	2 670	2 900
VVS150c	1300	1300	1080	2 730	2 730	2 940

Additional section length

Unit size	F	Н
	[mm]	[mm]
VVS021c	310	310 - 710
VVS030c	310	310 - 710
VVS040c	310	310 - 710
VVS055c	310	310 - 630
VVS075c	310	310 - 630
VVS100c	310	310 - 630
VVS120c	310	310 - 630
VVS150c	310	310 - 630


С	HC	S
[mm]	[mm]	[mm]
370 - 710	710	1080
370 - 710	710	1080
370 - 710	710	1080
450 - 790	790	1080
450 - 790	790	1080
890	890	1080
890	890	1080
920	920	1080


VENTUS COMPACT TOP - FLOOR-MOUNTED UNITS WITH VERTICAL DUCT CONNECTION

Base unit overall data


Unit size	Nominal airflow	Airflow range	Height	Width	Duct connection
	[m ³ /h]	[m ³ /h]	[mm]	[mm]	[mm]
VVS023c	2100	1250-2100	1176	880	700x445
VVS033c	3000	1800-3000	1447	880	700x513
VVS043c	4000	2400-4000	1737	880	700x613

Base unit lengths

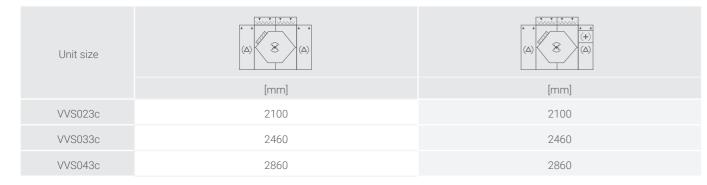

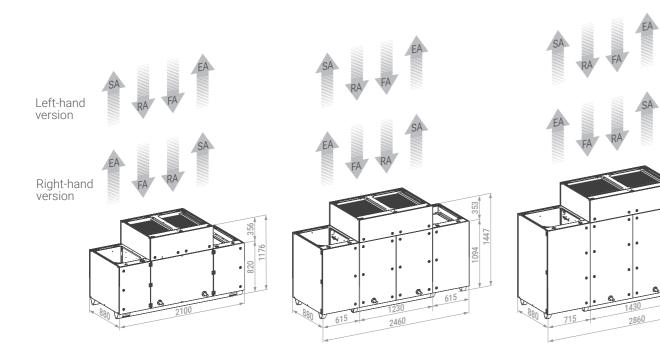

FA - fresh air intake SA - fresh air supply to the room RA - return air intake from the room EA - exhaust air ejection from the room



Base unit overall data


Unit size	Nominal airflow	Airflow range	Height	Width	Duct connection heigth	Duct connection width
	[m ³ /h]	[m ³ /h]	[mm]	[mm]	[mm]	[mm]
VVS021c	2100	1200-2100	991	967	345	860
VVS030c	3000	1500-3000	1255	967	480	860
VVS040c	4000	2000-4000	1255	1174	480	1065
VVS055c	5000	2500-5500	1525	1345	615	1235
VVS075c	7500	3750-7500	1765	1486	735	1380


* - the range of the heat pump function depends on the outdoor air parameters

Base unit lengths

Unit size		
VVS021c	2140	2140
VVS030c	2140	2140
VVS040c	2140	2140
VVS055c	2140	2140
VVS075c	2140	2140

Heat pump refrigeration system

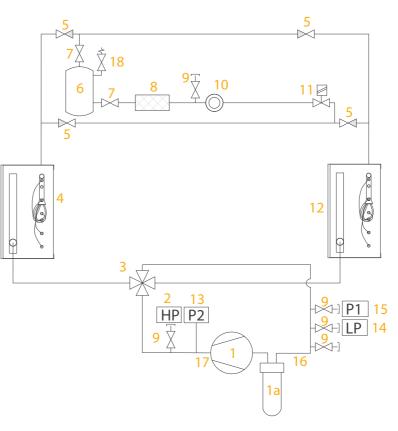



- Compressor 1
- 1a Liquid separator
- 2 High pressure switch
- 3 4-way valve
- Evaporator/Condenser 4
- 5 Check valve
- Liquid medium tank 6
- Shut-off valve (Rotalock) 7
- Filter drier 8
- 9 Service valve
- 10 Sight glass
- 11 Electronic expansion valve
- 12 Evaporator/Condenser
- 13 High-pressure transducer
- 14 Low-pressure transducer
- 15 Low-pressure switch
- 16 Suction temperature sensor
- 17 Discharge temperature sensor
- 18 Safety valve

mHMI application

VTS Group provides an mHMI app that enables start-up, monitoring of operation and parameter control of VENTUS compact and modular air handling units. The app can be downloaded from Google Play and App Store.





The app connects to the unit using Bluetooth technology. All you need to do is launch the app and activate the Bluetooth module, which is located in the automatic control cabinet. The app will automatically detect the unit which you can then connect to.



mHMI enables:

- » start up of the unit without the need for a physical HMI
- » monitoring the unit's operating parameters
- parameters, setting the unit's operating schedule, or viewing and clearing alarms.

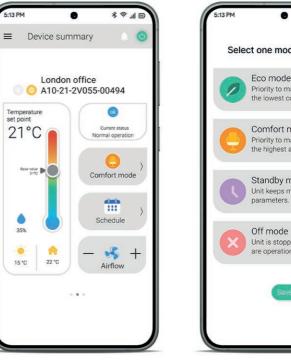

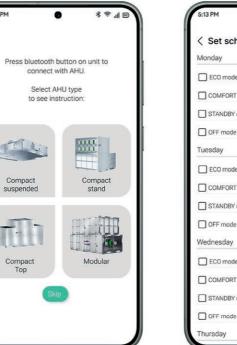

1

T

Compact Top

<	Set schedule
M	onday
	ECO mode
	COMFORT mode
	STANDBY mode
	OFF mode
Tu	lesday
	ECO mode
	COMFORT mode
	STANDBY mode
	OFF mode
We	ednesday
	ECO mode
	COMFORT mode
	STANDBY mode
	OFF mode
Th	ursday

» managing the unit's operation, including changing the operating modes, changing individual

	5:13 PM	30.
al 📼	-	h. ≈ *
	< Work mode	
	Londor	
	18-A10-21-2	V055-00494
	Eco m	
		to maintain est costs.
	Unit works with:	
	Temperature	19 °C 💥
	Humidity	20 % 💥
	Air quality (CO ₂)	1500 ppm 💥
	Fan supply	30 % 💥
	Fan return	30 % 💥
	Change	mode
	5:13 PM	۱۲ ۵ <i>۴</i>
	5:13 PM) ै ≑ all
	5:13 PM London 18-A10-21-21	office
	London	office
:00	London 18-A10-21-21	office
- D	London 18-A10-21-21 Main heater	office
00 00 00	London 18-A10-21-21 Main heater Regulator PID	office V055-00494
	London 18-A10-21-20 Main heater Regulator PID Regulation temperature	office V055-00494
_	London 18-A10-21-21 Main heater Regulator PID Regulation temperature	0 office V055-00494 100 100 °C
00 00 00	London 18-A10-21-21 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal Kp	0 office V055-00494 100 100 °C 100 % -999
	London 18-A10-21-21 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal Kp Ti	0 office V055-00494 100 100 °C 100 % -999 32 000 s
	London 18-A10-21-21 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal PID signal Kp Ti Ti Minimum	100ffice V055-00494 100 100 °C 100 % -999 32 000 s 100 %
	London 18-A10-21-21 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal PID signal Kp Ti Minimum Maximum	0 office V055-00494 100 100 °C 100 % 32 000 s 100 %
- 1 0 0 0 0 0	London 18-A10-21-20 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal Kp Ti Minimum Maximum Regulator PID - Water pr	100 100 100 °C 100 % -999 32 000 s 100 % 100 % 100 % 00 ctection
	London 18-A10-21-21 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal PID signal Kp Ti Minimum Maximum	0 office V055-00494 100 100 °C 100 % 32 000 s 100 % 0tection 100 %
	London 18-A10-21-20 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal Kp Ti Minimum Maximum Regulator PID - Water pr	100 100 100 °C 100 % -999 32 000 s 100 % 100 % 100 % 00 ctection
	London 18-A10-21-21 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal Kp Ti Minimum Maximum Regulator PID - Water pro	0 office V055-00494 100 100 °C 100 % 32 000 s 100 % 0tection 100 %
	London 18-A10-21-20 Main heater Regulator PID Regulation temperature Setpoint temperature PID signal Kp Ti Minimum Regulator PID - Water pr PID signal PID signal PID signal Freeze alarm	office v055-00494 100 100 °C 100 % -999 32 000 s 100 % 100 % otection 100 % -999°C

VMS – VENTUS MANAGEMENT SYSTEM

VTS supplies control system with a factory-implemented application for remote monitoring and management of the operating parameters of the units in real time via a web browser on any mobile device.

VENTUS MANAGEMENT SYSTEM:

- » Displaying visualisations on any devices from PC to mobile devices
- » Monitoring and management of the majority of devices from the open visualisation of a single unit
- » Easy and intuitive change of the operating mode of the unit using a central button
- » Tools for supporting easy and quick setup of the optimal operating schedule of the unit







Graphical operation calendar:

» Changing time intervals using sliders



Charts of unit's operation:

- » Two charts main and secondary
- Free selection of the set of parameters for monitoring and assigning them to selected ranges

	=	©300		VIS		EN .
ALARM	3					
ACTIVE AL	AMIS					
NO -	DATE	TIME	NAME			
HISTORICA						
NO.*	DATE	TME	NAME			
1	2020-09-10	14:23:04	Alarni - Antifreaze - Temperature Bao	k Water Heater		
2	2020-06-10	14:22:25	Alarm - Antitreeze - Temperature Back	k Walter Heatler		
3	2020-06-01	10.16.12	Aure - Fee			
4	2020-09-01	10.16.22	Alami - Prote - Temperature Exhaust			
6	2020-06-01	10.16/22	Aure - Prote - Temperature External			
•	2029-89-01	10:16:22	Alare - Piste - Tenperature Supply			
	(0		No alterna / No warringe	۲	()
	_	-				

Faults and alarms handling:

- » Clearing alarms
- » Alarm logging

≡ ©∞	VTS	PL DN
ECO		Summary of serings - Heat I Cost power - Electric power - East regulation
Mode work time		
	2	5 % ° % % 8 D 2 B 4 8 8 7 8 9 9
Total electric energy consumption: Node BCD Autors (d. BUR Node Carlos Harden 2 BUR Node Carlos (D. Alford 2 BUR Node - Carlos (D. Alford 2 BUR Burman: 186 Kills (2 BUR)	Achai	power [M]
AC/EC savings: 98 kWh'		al al a a a a a a a a a a a a a a a a a
	IVIS-ARGI (VIS-ARGI CON CON CON CON CON CON CON CON	9 🗑 🖗
	14	

Analysis of savings resulting from the operating scenario used:

- » Graphical representation of the use of particular energy media
- » Costs and savings shown in any currency.

CLIMACAD ONLINE 4.0 (CCOL 4)



CCOL4 IS COMPATIBLE WITH:

» all browsers





» all operating system








DATA EXPORT TO



VTS BIM - INNOVATIVE APPROACH TO DIGITAL MODELS OF AIR-HANDLING UNITS


VTS has created a possibility of dynamic online generation of digital models of the units VENTUS VVS, VENTUS Compact and American VENTUS AVS. This is possible due to the launch of the new ClimaCAD OnLine 4.0 product selection program that features an .rfa [Revit®] file generator

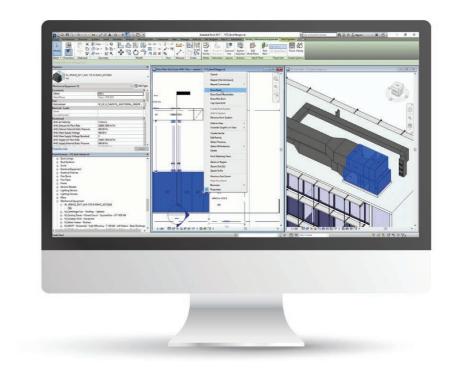


 \bigcirc

员


Ð




connectors:

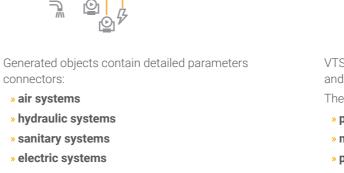

as well as the complete dimensional data, including unit's maintenance and service (repair) zone.





VTS also provides digital models of WING air curtains and VOLCANO air heaters.

The models contain:

- » parametrized electric and hydraulic connectors,
- » mount options vertically and horizontally,
- » presentation of the range of air stream,
- » parameter of any inclination angle of an air heater in relation to the horizontal plane.

VTS

UAB "VTS Vilnius"

Rygos g. 6-34 LT-05270 Vilnius, **Lithuania** Phone +370 (5) 263 61 52 Fax +370 (5) 263 61 56 vilnius@vtsgroup.com

VTS Latvia SIA

Bieķensalas iela 21, B218 Rīga, LV-1004, **Latvia** Phone + 371 67382530 latvia@vtsgroup.com

VTS Clima OÜ

Teaduspargi 6/1 12618 Tallinn, **Eesti** Phone +372 622 9010 estonia@vtsgroup.com

www.vtsgroup.com