


**B**

VS 10-75 CG uPC (AHU VS 21-75)  
VS 40-150 CG uPC SUP-EXH  
VS 180-300 CG uPC  
VS 400-650 CG uPC

APPLICATION: AP1121 / AP1249

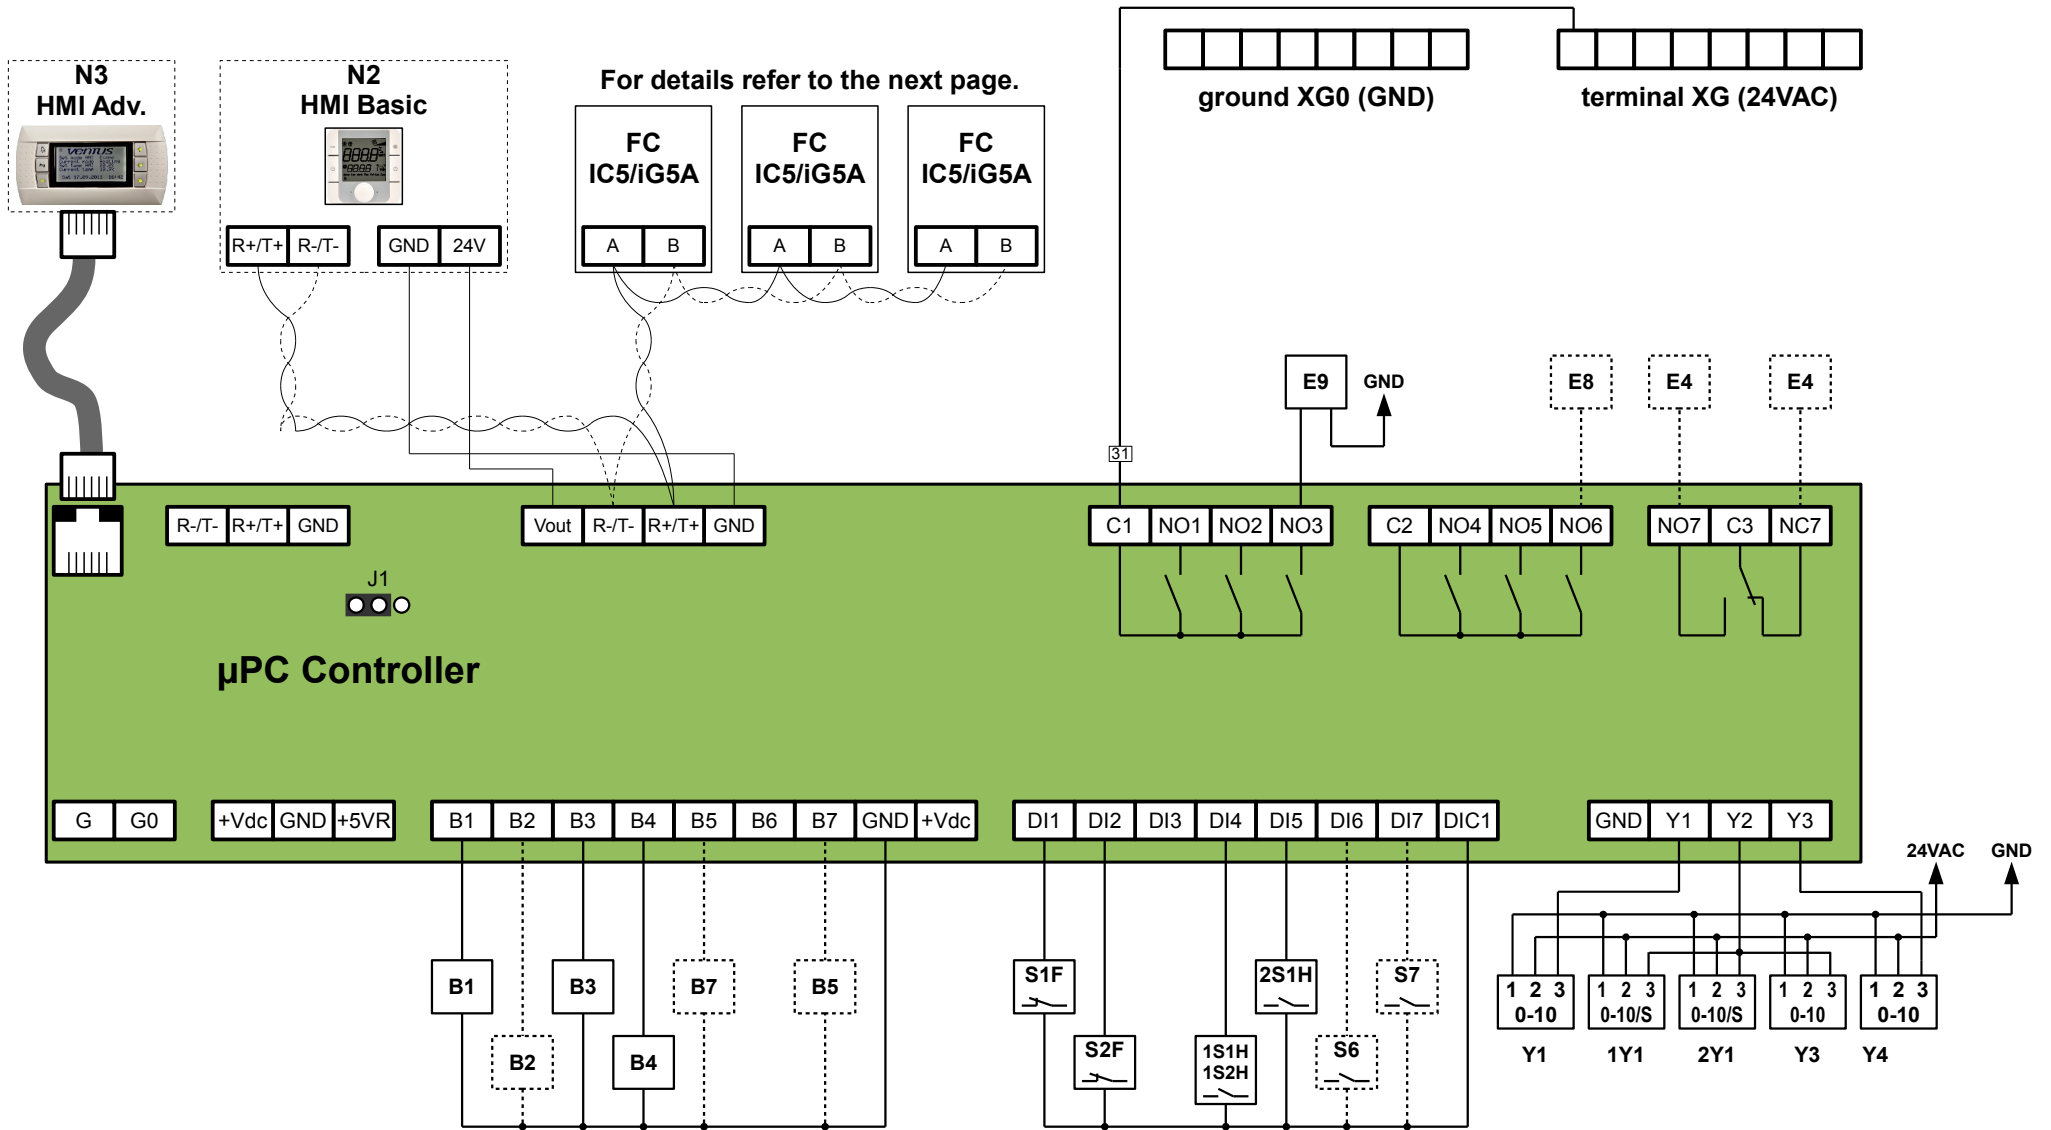

**B**

**MODBUS CONNECTION**



**SENSOR B2**

|                 | HMI Basic uPC = YES | HMI Basic uPC = NO |
|-----------------|---------------------|--------------------|
| App.Code A...-S | ✗                   | ✗                  |
| App.Code A...-R | ✗                   | B2 ✓               |
| App.Code A...-E | B2 ✓                | B2 ✓               |